



JACKSONVILLE WASTEWATER UTILITY
248 Cloverdale Rd.
Jacksonville, AR 72076
501-982-0581

No. 18-0047

RESIDENTIAL OR COMMERCIAL BUILDING SEWER CONNECTION PERMIT

Street Address 1501 W. Main Street

Legal Description (new home)

Facility to be connected to sewer:

Single Family Residence _____ *Multi-family Residential _____ Units _____

*Commercial Installation _____ Description: New Connection

Water Meter (s) Size _____ Irrigation System

* Commercial installations, and multi-family installations of more than 4 dwelling units must be accompanied by a site plan showing the proposed building sewer.

Sewer line installation by Robert D. Humber, P.E. 870-192 0858

Address: _____

General: _____


Address: _____

In construction: _____

1. To _____

2. To public _____

3. To _____

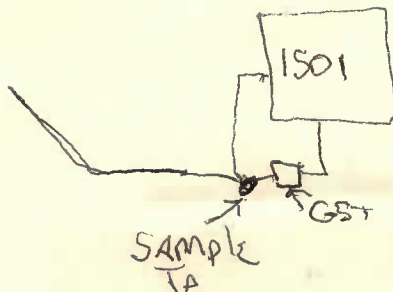

Fees: Connection Fee \$ 300 7/26/18 Receipt No. 114896

Tap Charge \$ _____ Receipt No. _____

Inspection Fee \$ 2500 9/26/18 Receipt No. 114896

Street Cut \$ _____ Receipt No. _____

APPLICANT Signed Ron Dwyer

- ☐ Plumbing Contractor
☐ General Contract
☐ Owner (Address _____)

David

APPROVED
Jacksonville Wastewater Utility

By: [Signature] Date: 7/25/18

1st Series
Copied
8/15/18
New contract
Completed 9/24/18
H



JACKSONVILLE WASTEWATER UTILITY
248 Cloverdale Rd.
Jacksonville, AR 72076
501-982-0581

No. 18-0047

RESIDENTIAL OR COMMERCIAL BUILDING SEWER CONNECTION PERMIT

Street Address 1501 W. Main Street

Legal Description (new Kumbo)

Facility to be connected to sewer:

Single Family Residence _____ *Multi-family Residential _____ Units _____

*Commercial Installation _____ Description: Capping Service

Water Meter (s) Size _____

* Commercial installations, and multi-family installations of more than 4 dwelling units must be accompanied by a site plan showing the proposed building sewer.

Sewer line installation by Robert L. ... 870-692 0852


Address _____

General Cont _____

Address _____


In consideration of:

1. To accept
2. To maintain public sewer
3. To notify the public

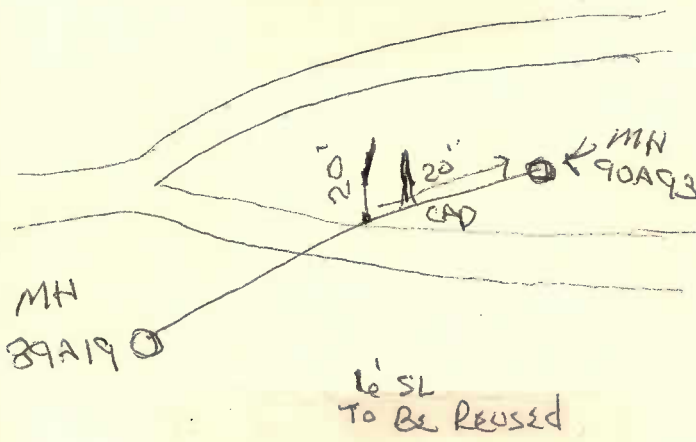

SERVICE
CAP in
MANHOLE.

16" SL
TO BE REUSED

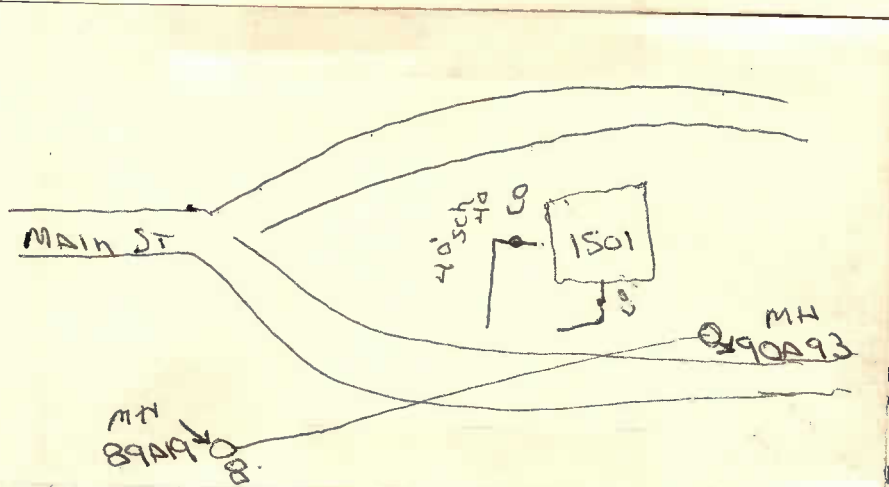

243

Service
capped
8/15/18

Service
capped
partial 8/19/18

APPROVED
Jacksonville Wastewater Utility

By: [Signature]

Date: 7/25/18